



CONTROLLER MODELS 4004, 4006 & 4008

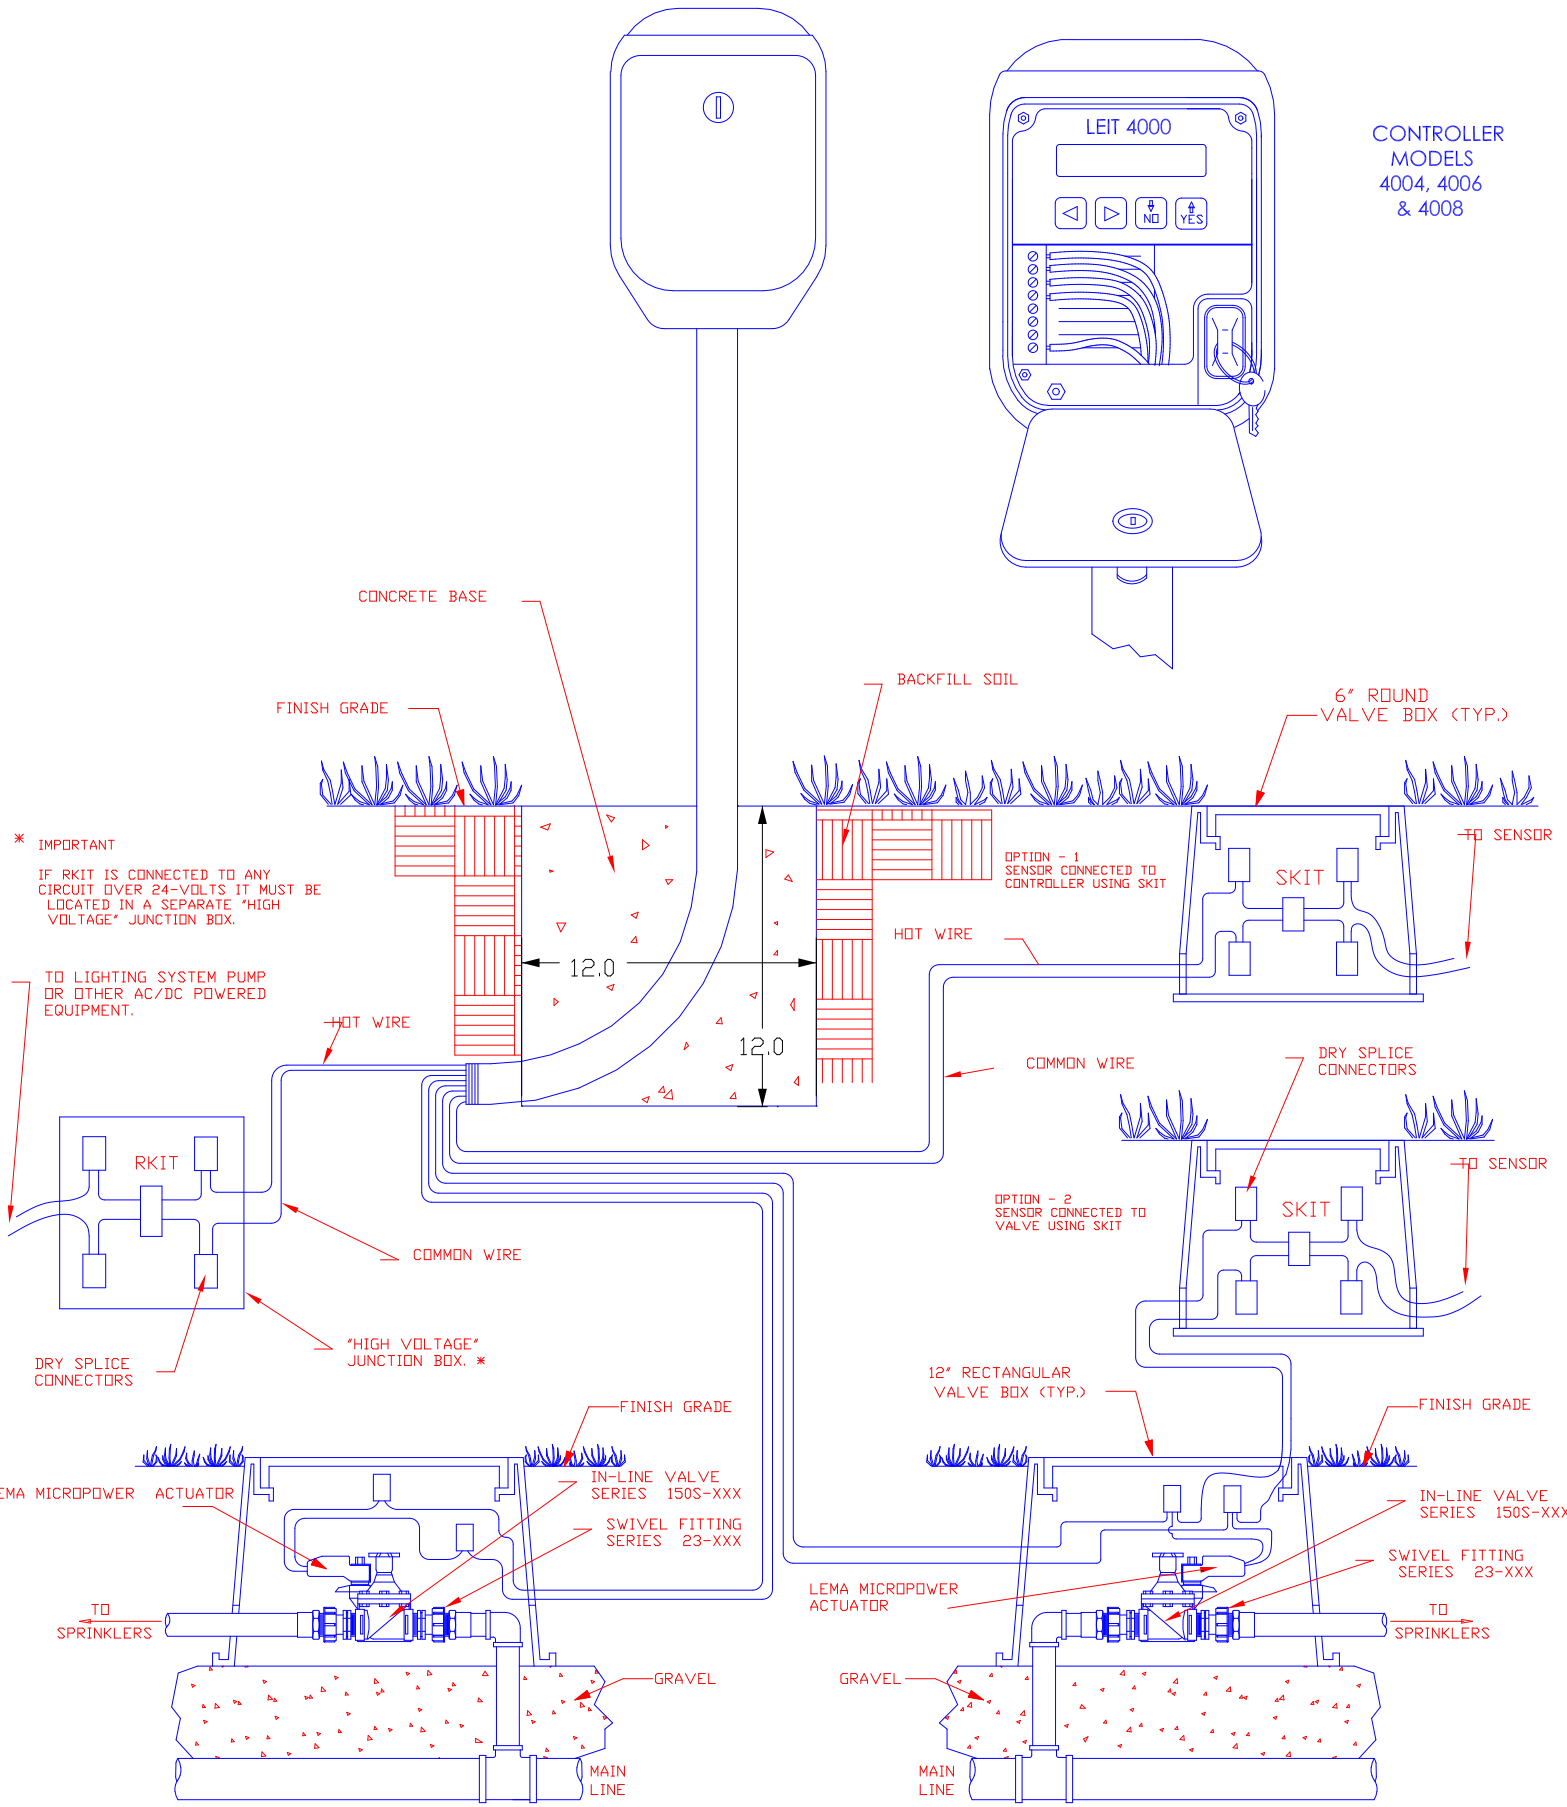


\* IMPORTANT  
IF RKIT IS CONNECTED TO ANY CIRCUIT OVER 24-VOLTS IT MUST BE LOCATED IN A SEPARATE "HIGH VOLTAGE" JUNCTION BOX.

TO LIGHTING SYSTEM PUMP OR OTHER AC/DC POWERED EQUIPMENT.



COMMON WIRE

"HIGH VOLTAGE" JUNCTION BOX. \*



LEMA MICROPOWER ACTUATOR

GRAVEL

MAIN LINE

8

### TYPICAL SYSTEM INSTALLATION LEIT 4000 USING 1500S ACTUATOR